



**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/07/2017
Received: 02/02/2017
Sampled By:
Work Order: 7033010


**C
L
I
E
N
T**
Tigard-Tualatin SD
Attn: Phil Wentz
6960 SW Sandburg St.
Tigard OR, 97223
Phone: (503) 431-4017

Project:
Project # : N/A
Sample Type :

Sampling Location: Fowler

Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7033010-01	Sample Name: Commons office Boys R Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/06/17 17:11
7033010-02	Sample Name: Commons office Girls R Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/06/17 17:11
7033010-03	Sample Name: Rm 11 Boys R Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	8.5	ppb	2.0	20 ppb	03/06/17 17:11
7033010-04	Sample Name: Rm 11 Girls R Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	10.8	ppb	2.0	20 ppb	03/06/17 17:11
7033010-05	Sample Name: Rm 12 Bubbler Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	14.2	ppb	2.0	20 ppb	03/06/17 17:11
7033010-06	Sample Name: Rm 12 Faucet Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	22.4	ppb	2.0	20 ppb	03/06/17 17:11 MCLE
7033010-07	Sample Name: Rm 13 Faucet Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	56.7	ppb	4.0	20 ppb	03/06/17 17:11 MCLE
7033010-08	Sample Name: Rm 13 Bubbler Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	18.7	ppb	2.0	20 ppb	03/06/17 17:11
7033010-09	Sample Name: Rm 14 Bubbler Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	4.3	ppb	2.0	20 ppb	03/06/17 17:11
7033010-10	Sample Name: Rm 14 faucet Sampled: 2/1/17 3:30						Matrix: Water
+Lead	1030	EPA 200.9	37.9	ppb	2.0	20 ppb	03/06/17 17:11 MCLE

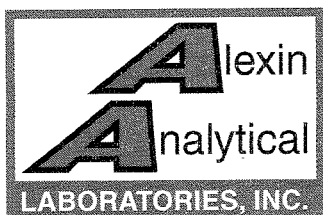

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional
Laboratory
Services**

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/07/2017

Received: 02/02/2017

Sampled By:

Work Order: 7033010

C
L
I
E
N
T

Tigard-Tualatin SD
Attn: Phil Wentz
6960 SW Sandburg St.
Tigard OR, 97223
Phone: (503) 431-4017

Project:


Project # : N/A

Sample Type :

Sampling Location: Fowler

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time	
7033010-11	Sample Name: Rm 15 Bubblers Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	8.8	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-12	Sample Name: Rm 15 faucet Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	12.8	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-13	Sample Name: Rm 21 faucet Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	74.9	ppb	8.0	20 ppb	03/06/17 17:11 MCLE	
7033010-14	Sample Name: Rm 21 Bubblers Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	18.7	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-15	Sample Name: Rm 17 bubbler Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	14.5	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-16	Sample Name: Rm 17 faucet Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	48.0	ppb	4.0	20 ppb	03/06/17 17:11 MCLE	
7033010-17	Sample Name: Rm 16 faucet Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	39.8	ppb	4.0	20 ppb	03/06/17 17:11 MCLE	
7033010-18	Sample Name: Rm 16 Bubblers Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	18.1	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-19	Sample Name: Rm 19 Bubblers Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	16.1	ppb	2.0	20 ppb	03/06/17 17:11	
7033010-20	Sample Name: Rm 19 faucet Sampled: 2/1/17 3:45							Matrix: Water
+Lead	1030	EPA 200.9	40.9	ppb	4.0	20 ppb	03/06/17 17:11 MCLE	

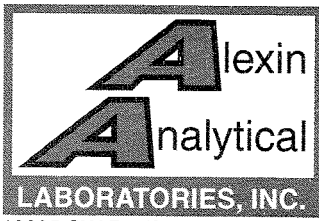

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013


Reported: 03/07/2017
Received: 02/02/2017
Sampled By:
Work Order: 7033010

C Tigard-Tualatin SD
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :

Sampling Location: Fowler

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7033010-21	Sample Name: Rm 20 faucet Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	13.6	ppb	2.0	20 ppb	03/06/17 17:11
7033010-22	Sample Name: Rm 20 Bubbler Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	42.0	ppb	4.0	20 ppb	03/06/17 17:11 MCLE
7033010-23	Sample Name: Rm 21 Boys Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	3.7	ppb	2.0	20 ppb	03/06/17 17:11
7033010-24	Sample Name: Rm 23 faucet left 2nd Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	72.6	ppb	4.0	20 ppb	03/06/17 17:11 MCLE
7033010-25	Sample Name: Rm 26 faucet by eye wash Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	16.9	ppb	2.0	20 ppb	03/06/17 17:11
7033010-26	Sample Name: Rm 27 1st faucet left Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	11.5	ppb	2.0	20 ppb	03/06/17 17:11
7033010-27	Sample Name: Rm 28 faucet by eye wash Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	9.1	ppb	2.0	20 ppb	03/06/17 17:11
7033010-28	Sample Name: Rm 35 bubbler Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	12.3	ppb	2.0	20 ppb	03/06/17 17:11
7033010-29	Sample Name: Rm 35 faucet Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	29.5	ppb	2.0	20 ppb	03/06/17 17:11 MCLE
7033010-30	Sample Name: Rm 36 faucet Sampled: 2/1/17 4:00		Matrix: Water				
+Lead	1030	EPA 200.9	17.3	ppb	2.0	20 ppb	03/06/17 17:11

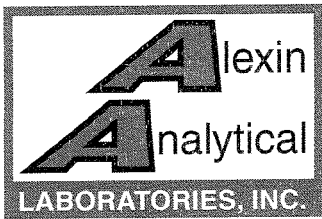

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 03/07/2017
Received: 02/02/2017
Sampled By:
Work Order: 7033010

**C
L
I
E
N
T**
Tigard-Tualatin SD
Attn: Phil Wentz
6960 SW Sandburg St.
Tigard OR, 97223
Phone: (503) 431-4017

Project:
Project # : N/A
Sample Type :

Sampling Location: Fowler

Lab Number


Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7033010-31	Sample Name: Staff faucet Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/06/17 17:11
7033010-32	Sample Name: Library by office faucet Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	34.8	ppb	2.0	20 ppb	03/06/17 17:11 MCLE
7033010-33	Sample Name: Library by office bubbler Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	33.3	ppb	4.0	20 ppb	03/06/17 17:11 MCLE
7033010-34	Sample Name: Office Mens Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	5.2	ppb	2.0	20 ppb	03/06/17 17:11
7033010-35	Sample Name: Office Womens R Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	03/06/17 17:11
7033010-36	Sample Name: Office Health Room Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	6.5	ppb	2.0	20 ppb	03/06/17 17:11
7033010-37	Sample Name: Rm 26 Bubbler Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	17.0	ppb	2.0	20 ppb	03/06/17 17:11
7033010-38	Sample Name: Rm 11 Bubbler Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	6.8	ppb	2.0	20 ppb	03/06/17 17:11
7033010-39	Sample Name: Rm 11 Faucet Sampled: 2/1/17 4:20		Matrix: Water				
+Lead	1030	EPA 200.9	28.7	ppb	2.0	20 ppb	03/06/17 17:11 MCLE

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL

MRL = Minimum Reporting Limit

MCL = Maximum Contamination Limit

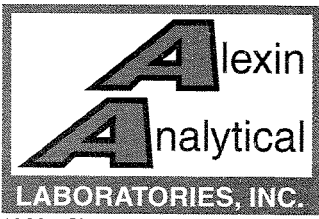

Professional Laboratory Services

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/07/2017

Received: 02/02/2017

Sampled By:

Work Order: 7033010

C Tigard-Tualatin SD
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:

Project # : N/A

Sample Type :

Sampling Location: Fowler

Lab Number

†All procedures for this analysis are in accordance with NELAP standards.

* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: _____


Adriana Gonzalez-Gray
Laboratory Director