

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

This report shows the results from the water retesting that occurred during the week of Jan. 2. These results reflect sampling efforts that are consistent with the EPA's testing procedure guidelines. At Bridgeport, those tests included a "flushed" sample. Based on those sampling efforts, none of the follow-up "flushed" test results exceeded the EPA's actionable level of 20 ppb (parts per billion).

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/12/2017

Received: 01/05/2017

Sampled By:

Work Order: 7005008

**C** Tigard-Tualatin SD  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**

Project # : N/A

Sample Type :

Sampling Location: Bridgeport


### Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time	
<b>7005008-01</b>	<b>Sample Name:</b> Rm 5 faucet flush <b>Sampled:</b> 1/5/17 6:20							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-02</b>	<b>Sample Name:</b> Rm 5 bubbler flush <b>Sampled:</b> 1/5/17 6:20							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	7.7	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-03</b>	<b>Sample Name:</b> Rm 9 faucet flush <b>Sampled:</b> 1/5/17 6:30							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.1	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-04</b>	<b>Sample Name:</b> Rm 9 bubbler flush <b>Sampled:</b> 1/5/17 6:30							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-05</b>	<b>Sample Name:</b> Rm 13B faucet flush <b>Sampled:</b> 1/5/17 6:35							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-06</b>	<b>Sample Name:</b> Kitchen Right faucet flush <b>Sampled:</b> 1/5/17 6:40							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	5.6	ppb	2.0	20 ppb	01/09/17 16:28	
<b>7005008-07</b>	<b>Sample Name:</b> Kitchen Left faucet flush <b>Sampled:</b> 1/5/17 6:40							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.8	ppb	2.0	20 ppb	01/10/17 16:19	
<b>7005008-08</b>	<b>Sample Name:</b> Kitchen prep sink <b>Sampled:</b> 1/5/17 6:40							<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	4.5	ppb	2.0	20 ppb	01/10/17 16:19	

**ND** = None detected at the MRL      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

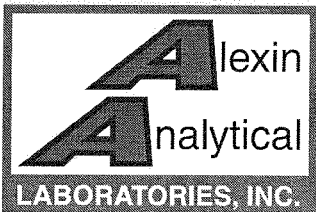

Professional  
Laboratory  
Services

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 01/12/2017

Received: 01/05/2017

Sampled By:

Work Order: 7005008

**C** **Tigard-Tualatin SD**  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**

Project # : N/A

Sample Type :

Sampling Location: Bridgeport


---

## Lab Number

---

Approved by: \_\_\_\_\_

  
Adriana Gonzalez-Gray  
Laboratory Director

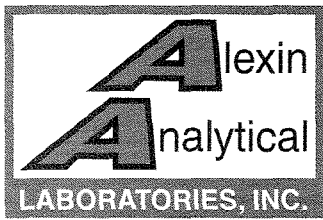

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

This report shows the results of water sampling tests completed in November 2016. Results higher than the EPA's actionable level of 20 ppb were retested in January 2017. The retest results appear on page 1 and 2 of this document.

Reported: 12/19/2016

Received: 11/08/2016

Sampled By: P. Wentz

Work Order: 6313011


**C** Tigard-Tualatin SD  
**L**  
**I** Attn: Phil Wentz  
**E** 6960 SW Sandburg St.  
**N** Tigard OR, 97223  
**T** Phone: (503) 431-4017

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Bridgeport

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6313011-01</b>	<b>Sample Name:</b> Rm 5 - faucet <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	54.9	ppb	4.0	20 ppb	12/14/16 16:30 MCLE
<b>6313011-02</b>	<b>Sample Name:</b> Rm 5 - bubbler <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	37.9	ppb	4.0	20 ppb	12/14/16 16:30 MCLE
<b>6313011-03</b>	<b>Sample Name:</b> Rm 17 - faucet <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	17.8	ppb	2.0	20 ppb	12/14/16 16:30
<b>6313011-04</b>	<b>Sample Name:</b> Rm 17 - bubbler <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	12/14/16 16:30
<b>6313011-05</b>	<b>Sample Name:</b> Rm 9 - faucet <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	54.8	ppb	4.0	20 ppb	12/14/16 16:30 MCLE
<b>6313011-06</b>	<b>Sample Name:</b> Rm 9 - bubbler <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	7.3	ppb	2.0	20 ppb	12/14/16 16:30
<b>6313011-07</b>	<b>Sample Name:</b> Rm 13 B - faucet <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	40.7	ppb	4.0	20 ppb	12/14/16 16:30 MCLE
<b>6313011-08</b>	<b>Sample Name:</b> Rm 13 B - bubbler <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	11.2	ppb	2.0	20 ppb	12/14/16 16:30
<b>6313011-09</b>	<b>Sample Name:</b> Rm 13 A - faucet <b>Sampled:</b> 11/8/16 4:00		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	11.4	ppb	2.0	20 ppb	12/14/16 16:30
<b>6313011-10</b>	<b>Sample Name:</b> Kitchen Left Faucet <b>Sampled:</b> 11/8/16 4:40		<b>Matrix:</b> Water				
+Lead	1030	EPA 200.9	65.7	ppb	4.0	20 ppb	12/14/16 16:30 MCLE

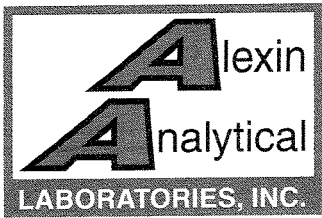

Professional Laboratory Services

13035 SW Pacific Hwy Tigard, OR 97223 Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 12/19/2016

Received: 11/08/2016

Sampled By: P. Wentz

Work Order: 6313011

CLIENT Tigard-Tualatin SD Attn: Phil Wentz 6960 SW Sandburg St. Tigard OR, 97223 Phone: (503) 431-4017

Project: Project #: N/A Sample Type:

Sampling Location: Bridgeport

Lab Number

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL MRL = Minimum Reporting Limit MCL = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: [Signature] Adriana Gonzalez-Gray Laboratory Director